



Lawhon & Associates, Inc.

ENVIRONMENTAL CONSULTING AND ENGINEERING SERVICES

Columbus

Cleveland

Dayton

August 19, 2016

Mr. Tim Gehring
Director of Facilities Management
Worthington City School District
250 East Wilson Bridge Road
Worthington, Ohio 43085

Re: Lead in Water Testing at McCord Middle School
1500 Hard Rd, Columbus, OH 43235
Sample Date: June 27, 2016
L&A Project No: 16-0311

Dear Mr. Gehring,

Lawhon & Associates, Inc. (L&A) performed water sampling to document concentrations of lead in the potable water system. There is no federal law requiring testing of drinking water in schools, except for schools that have their own water supply and are thus regulated under the Safe Drinking Water Act (SDWA). This testing was performed as a proactive measure to ensure lead in drinking water concentrations remain at acceptable levels. L&A's conclusions and recommendations relevant to the sampling performed are presented in this document.

METHODOLOGY

L&A performed environmental sampling for lead in water at McCord Middle School on June 27, 2016. The sampling was conducted in accordance with the United States Environmental Protection Agency's (US EPA) guidance document "3Ts (Training, Testing, and Telling) for Reducing Lead in Drinking Water in Schools" (3Ts Guidance); however, a larger sample volume was collected due to laboratory requirements for Ohio EPA certified methods. A sampling plan was developed for the facility, which prioritized drinking water sources based on potential use and risk. Field activities included the collection of one (1) liter first draw water samples from the water main (or first outlet off the water main), drinking fountains, kitchen sinks, and approximately 10% of classroom sinks or other potential drinking water sources. Flushed samples were collected and submitted for analysis only if the first draw sample from the same fixture exceeded the US EPA Action Level. Prior to sample collection, the potable water system was not used for a minimum of 8 hours. Samples were collected by Mr. Shawen Jenkins, Ohio Department of Health (ODH) certified Lead Risk Assessor (LRA) #LA9297. Samples were submitted to MASI Environmental Laboratories located in Plain City, Ohio for analysis using the EPA method SM3113B. MASI is certified by the Ohio EPA for lead in drinking water analysis.

REGULATORY ACTION LEVELS

US EPA's 3T's Guidance recommends an action level of 20 parts per billion (ppb) for lead; however, Ohio Facilities Construction Commission (OFCC) Lead Plumbing Fixture Replacement Assistance Grants Program has set an action level of 15 ppb for lead which is consistent with


the action level for lead set by EPA's Lead and Copper Rule, under the National Primary Drinking Water Regulations (NPDWR).

For the purposes of this assessment, L&A has utilized an action level of 15 ppb lead for comparison with the laboratory analytical results.


FINDINGS

L&A collected twenty-one (21) first draw water samples at McCord Middle School. A diagram of the sampling locations is presented in Appendix A. As illustrated on the following graph, lead was detected above the action level in one sample location:

- Kitchen Sink North Sprayer (East Wall) (186 µg/L)

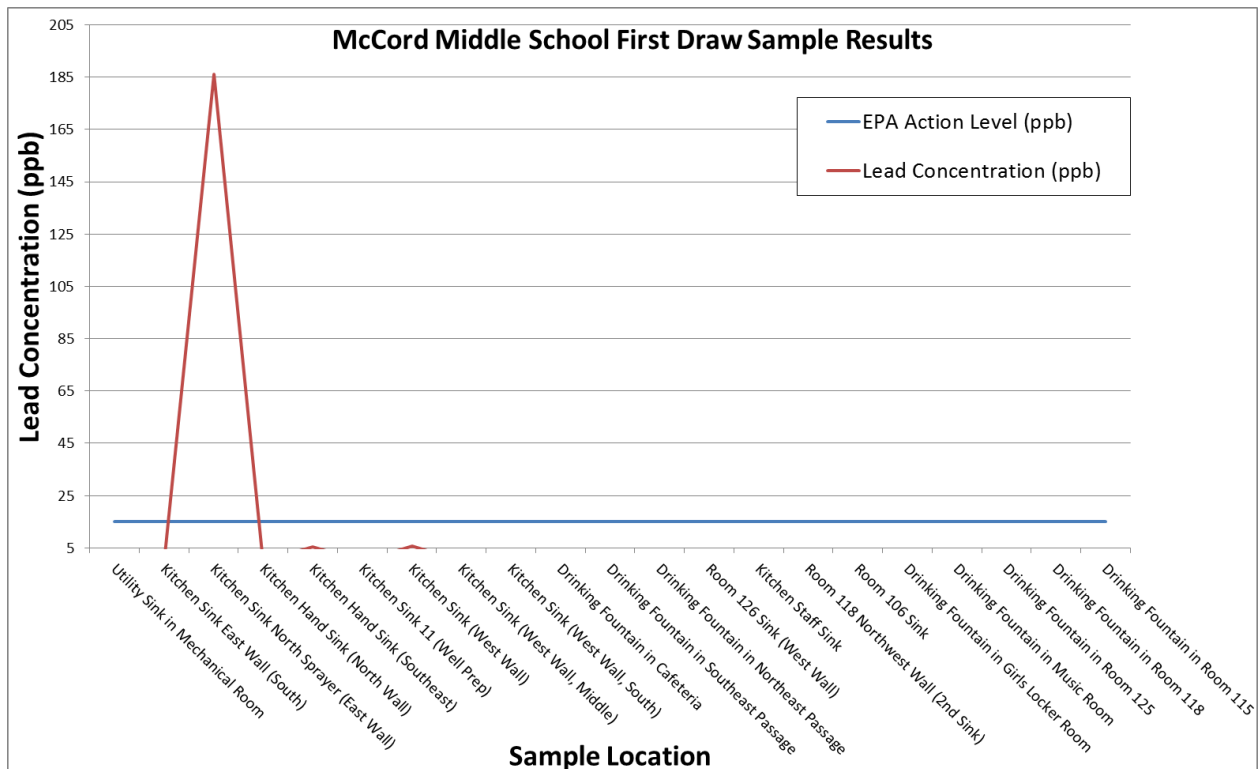

L&A collected and submitted a flush sample for this location. As illustrated on the following graph, the lead concentrations in the flush sample collected were reported below the action level and the detection limit.

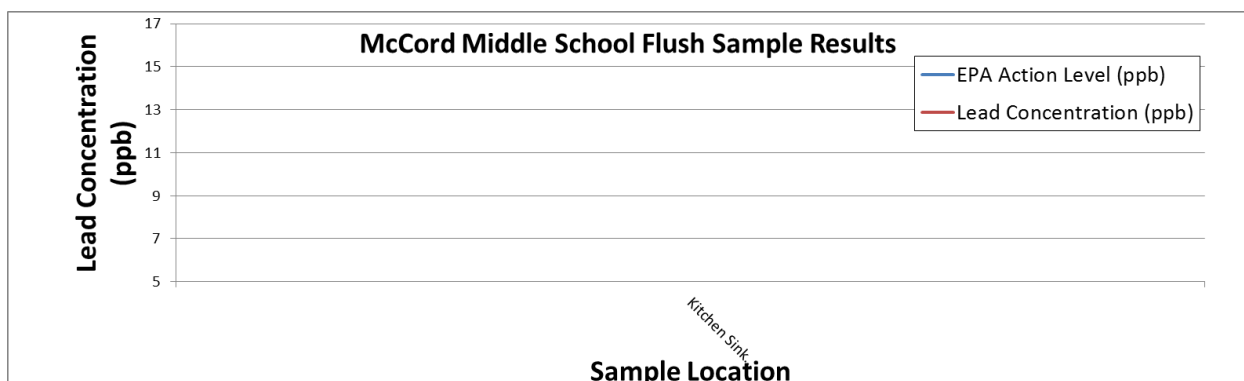

A comprehensive data table is included as Appendix B. A copy of the laboratory report is included in Appendix C.

CONCLUSIONS

The results of L&A's sampling indicate that the following location had lead concentrations found in excess of the action level in the first draw sample but below the action level in the subsequent flush sample, indicating that the source of lead is likely in the fixture itself or the plumbing connecting the fixture to the lateral, and very little lead is likely coming from the plumbing upstream of the fixture:

- Kitchen Sink North Sprayer (East Wall)

Based on the results, L&A recommends cleaning out the aerator screen of the Kitchen Sink North Sprayer (East Wall), replacing any lead containing components, or replacing the entire fixture and retesting to confirm that the lead in water concentration no longer exceeds the action level.

CLOSURE

L&A has prepared this report for your use in accordance with generally accepted inspection and testing practices. The information obtained in this report is site and time specific and pertains to this project only. This inspection evaluated the conditions that were readily accessible at the time of the investigation of the subject property and does not warrant against hidden conditions or future alteration of conditions at the site, as well as subsequent changes in regulations. This report should not be construed as a full Lead Risk Assessment.

This report was prepared for the exclusive use of the Worthington City School District. No other party may rely on this report unless expressly designated by the Client in writing. The use of the report is subject to the limitations and exceptions set forth in this report, as well as the terms and conditions contained in the original contract documents. L&A will not distribute or publish this report without the Client's consent, except as required by law or court order.

Thank you for the opportunity to assist you in this important matter. If you have any questions concerning this report, please contact Shawen Jenkins or Tim Price at (614) 481-8600.

Sincerely,




Shawen Jenkins, Lead Risk Assessor
Environmental Scientist



Tim Price
Senior Project Manager

APPENDIX A
Sample Location Diagram

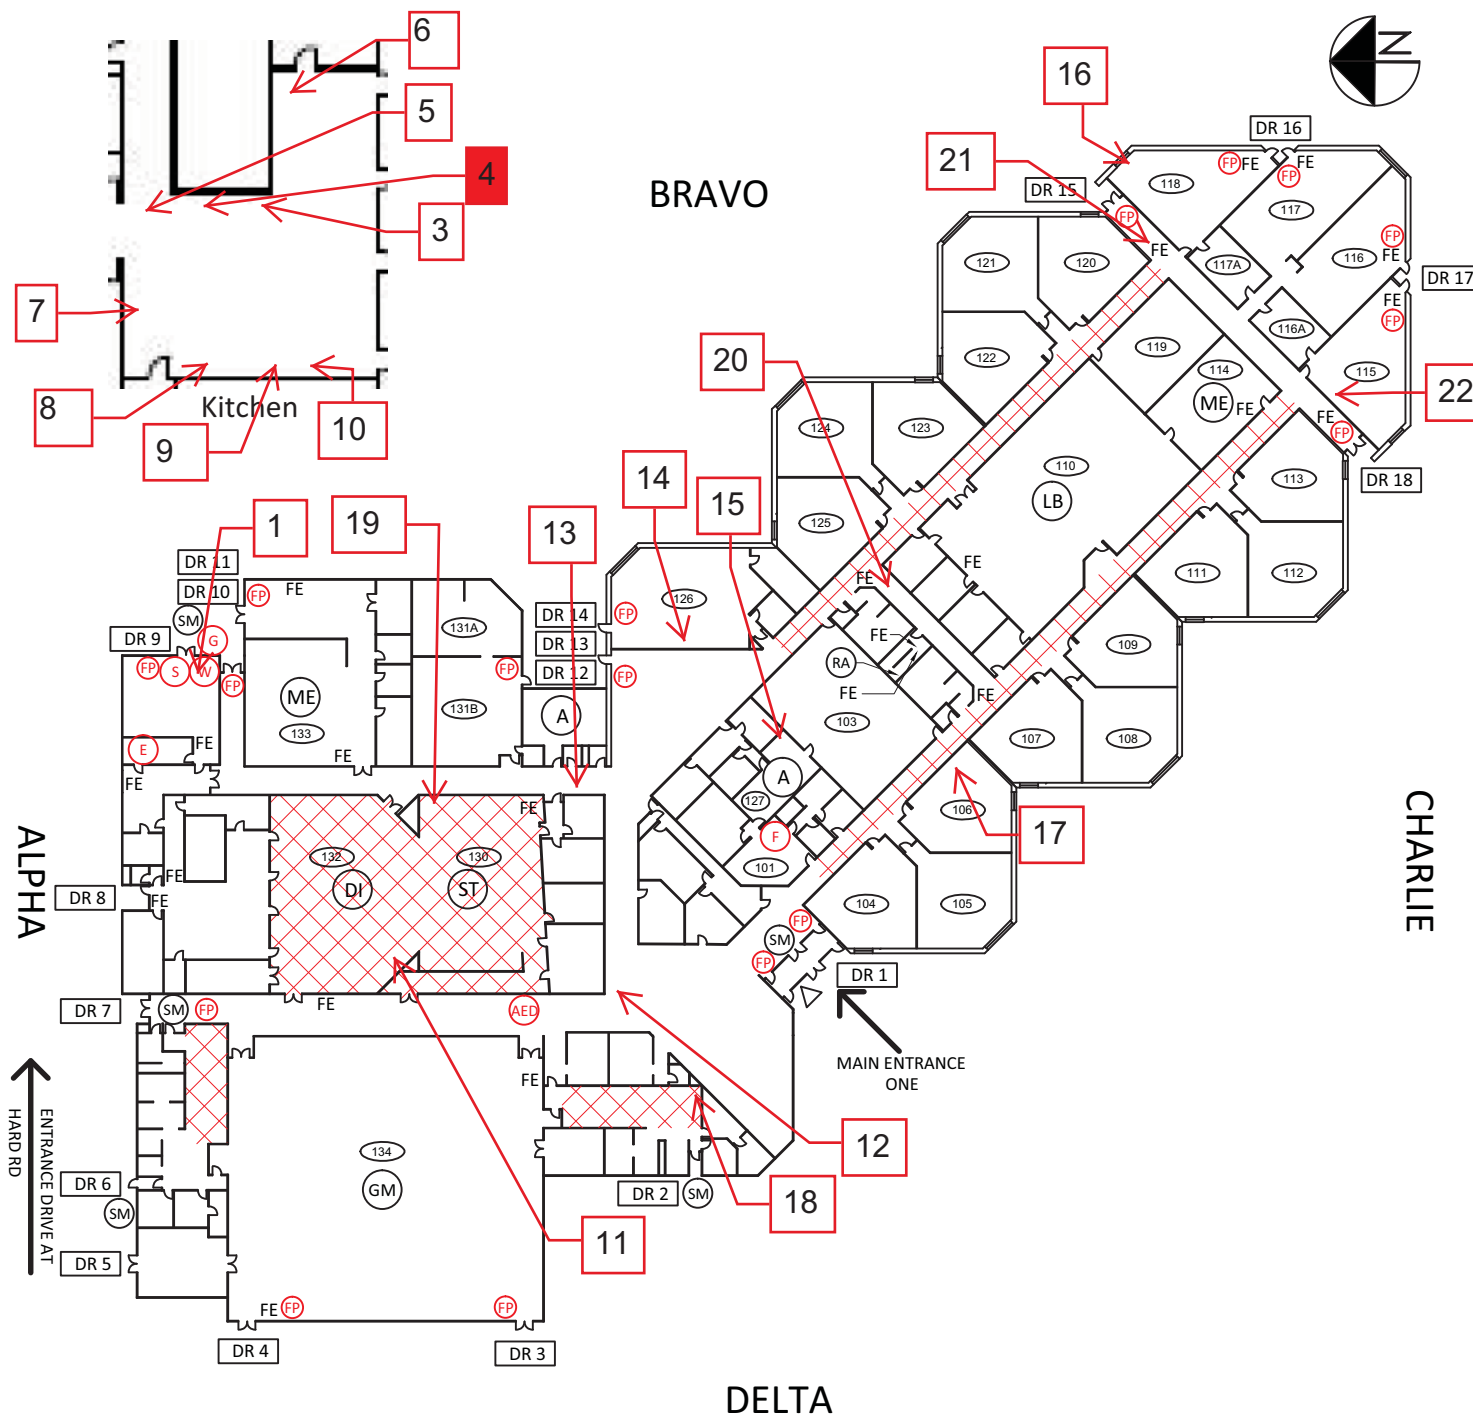

CRITICAL		TORNADO EVAC. SITE
		FIRE PULL STATIONS
		LOCATION OF EXISTING AED
		ELECTRICAL SHUTOFF
		FIRE ALARM PANEL
		GAS SHUTOFF
		KNOX BOX
NON-CRITICAL		SPRINKLER SHUTOFF
		WATER SHUTOFF
		ADMINISTRATIVE SUITE
		AREA OF REFUGE
		CAMERA
		CORRIDOR
		ELEVATOR
COMMON AREAS		EXTERIOR DOORS
		FIRE EXTINGUISHER
		LOCATION OF BLUEPRINTS
		ROOF ACCESS POINT
		ROOM NUMBER
		SECURITY MONITORING AND ACCESS CONTROL
		SERVICE ENTRANCE
		MULTIPURPOSE ROOM
		LIBRARY
		DINING
WORTHINGTON SCHOOLS McCORD MIDDLE SCHOOL 1500 HARD RD. WORTHINGTON FACILITY SAFETY PLAN OHIO FACILITIES CONSTRUCTION COMMISSION		
IRN:		095794
BUILDING TELEPHONE NUMBER:		(614) 450-4000
EMERGENCY TELEPHONE NUMBER:		(614) 560-4147

APPENDIX B
Comprehensive Data Table

Table 1: Potable Water Sampling Results

Sample ID	Sampling Site	Sample Type	Meets Non-Use Period	Recalled Fixture	Analytical Results (ppb)
MM-1	Utility Sink in Mechanical Room	First Draw	Yes	No	<5
MM-3	Kitchen Sink East Wall (South)	First Draw	Yes	No	<5
MM-4	Kitchen Sink North Sprayer (East Wall)	First Draw	Yes	No	186
MM-5	Kitchen Hand Sink (North Wall)	First Draw	Yes	No	<5
MM-6	Kitchen Hand Sink (Southeast)	First Draw	Yes	No	5.3
MM-7	Kitchen Sink 11 (Well Prep)	First Draw	Yes	No	<5
MM-8	Kitchen Sink (West Wall)	First Draw	Yes	No	5.6
MM-9	Kitchen Sink (West Wall, Middle)	First Draw	Yes	No	<5
MM-10	Kitchen Sink (West Wall, South)	First Draw	Yes	No	<5
MM-11	Drinking Fountain in Cafeteria	First Draw	Yes	No	<5
MM-12	Drinking Fountain in Southeast Passage	First Draw	Yes	No	<5
MM-13	Drinking Fountain in Northeast Passage	First Draw	Yes	No	<5
MM-14	Room 126 Sink (West Wall)	First Draw	Yes	No	<5
MM-15	Kitchen Staff Sink	First Draw	Yes	No	<5
MM-16	Room 118 Northwest Wall (2nd Sink)	First Draw	Yes	No	<5
MM-17	Room 106 Sink	First Draw	Yes	No	<5
MM-18	Drinking Fountain in Girls Locker Room	First Draw	Yes	No	<5
MM-19	Drinking Fountain in Music Room	First Draw	Yes	No	<5
MM-20	Drinking Fountain in Room 125	First Draw	Yes	No	<5
MM-21	Drinking Fountain in Room 118	First Draw	Yes	No	<5
MM-22	Drinking Fountain in Room 115	First Draw	Yes	No	<5
MM-23	Kitchen Sink North Sprayer (East Wall)	Flush	Yes	No	<5
1. Detection limit is 5.0 ppbl. 2. Bold indicates lead present above detection limits. 3. Highlighting indicates lead concentrations exceed the EPA Action Level.					

APPENDIX C
Laboratory Analytical Reports

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415570-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.	Private
Sampler Name: SHAWEN JENKINS	County: FRANKLIN
Sample Date: 06/27/16	Chlorinated:
Sample Time: 08:00	Repeat No:
Sample Matrix: POTABLE	C12 Total:
Sample Monitoring Point: MM 1	C12 Free:
Sample Tap: UTILITY SINK IN MECH	C12 Combined:
Sample Type:	
Sample Address: 1500 HARD ROAD WORTHINGTON OH 43235	
Sample ID:	

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48617	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415572-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:04
Sample Matrix: POTABLE
Sample Monitoring Point: MM 3
Sample Tap: K SINK E WALL SOUTH
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48620	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415573-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:06
Sample Matrix: POTABLE
Sample Monitoring Point: MM 4
Sample Tap: K SINK E WALL N SPRAYER
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48781	3113B	4792	07/01/16
186 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415574-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:10
Sample Matrix: POTABLE
Sample Monitoring Point: MM 5
Sample Tap: K HAND SINK N WALL
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48614	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415575-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:12
Sample Matrix: POTABLE
Sample Monitoring Point: MM 6
Sample Tap: K SINK SE HAND SINK
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48782	3113B	4792	07/01/16
5.3 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415576-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:14
Sample Matrix: POTABLE
Sample Monitoring Point: MM 7
Sample Tap: K SINK 11 WELL PREP
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48454	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415577-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:16
Sample Matrix: POTABLE
Sample Monitoring Point: MM 8
Sample Tap: K SINK W WALL SPIGOT
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48457	3113B	4792	07/01/16
5.6 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415578-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:18
Sample Matrix: POTABLE
Sample Monitoring Point: MM 9
Sample Tap: K SINK W WALL MIDDLE SINK
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48458	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415579-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:20
Sample Matrix: POTABLE
Sample Monitoring Point: MM 10
Sample Tap: K SINK W WALL S
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48460	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415580-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:22
Sample Matrix: POTABLE
Sample Monitoring Point: MM 11
Sample Tap: DF CAFETERIA
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48462	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415581-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:24
Sample Matrix: POTABLE
Sample Monitoring Point: MM 12
Sample Tap: DF SE PASSAGE
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48475	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415582-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:26
Sample Matrix: POTABLE
Sample Monitoring Point: MM 13
Sample Tap: DF NE PASSAGE
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48474	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415583-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:28
Sample Matrix: POTABLE
Sample Monitoring Point: MM 14
Sample Tap: RM 126 SINK W WALL
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48473	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415584-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:30
Sample Matrix: POTABLE
Sample Monitoring Point: MM 15
Sample Tap: K SINK STAFF
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48472	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415585-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:32
Sample Matrix: POTABLE
Sample Monitoring Point: MM 16
Sample Tap: RM 118 NW WALL 2ND SINK
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48471	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415586-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:34
Sample Matrix: POTABLE
Sample Monitoring Point: MM 17
Sample Tap: RM 106 SINK
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48470	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415587-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:38
Sample Matrix: POTABLE
Sample Monitoring Point: MM 18
Sample Tap: DF GIRLS LOCKER RM
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48469	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415588-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: LAWHON
Sample Date: 06/27/16
Sample Time: 08:40
Sample Matrix: POTABLE
Sample Monitoring Point: MM 19
Sample Tap: DF MUSIC RM
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48468	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415589-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:42
Sample Matrix: POTABLE
Sample Monitoring Point: MM 20
Sample Tap: DF RM 125
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48467	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415590-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:44
Sample Matrix: POTABLE
Sample Monitoring Point: MM 21
Sample Tap: DF RM 118
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	48466	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/05/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0415591-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 06/27/16
Sample Time: 08:46
Sample Matrix: POTABLE
Sample Monitoring Point: MM 22
Sample Tap: DF RM 115
Sample Type:
Sample Address: 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
Cl2 Total:
Cl2 Free:
Cl2 Combined:

Test Requested	Lab Number	Method Number	Analyst Number	Date Analyzed
LEAD	48464	3113B	4792	07/01/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC

Certificate of Analysis - Fax Copy

MASI ENVIRONMENTAL SERVICES

P. O. Box 1440
Dublin, Ohio 43017
(614) 873-4654

Page: 1
Date: 07/28/16

LAWHON & ASSOCIATES, INC.
CHUCK WILSON
1441 KING AVENUE

COLUMBUS OH 43212

Client No: 0000005911
AR Sheet No: 0409418-AR
MASI Dublin Laboratory: 877
MASI Cincinnati Laboratory: 4100
PWS ID No:
STU ID No:
PO No:

Dear Client:

Along with your results listed below we would like to thank you for allowing MASI to assist you with your environmental testing requirements.

Account Name: LAWHON & ASSOCIATES, INC.
Sampler Name: SHAWEN JENKINS
Sample Date: 07/22/16
Sample Time: 08:00
Sample Matrix: POTABLE
Sample Monitoring Point: MM23
Sample Tap: KITCHEN EAST WALL NORTH
Sample Type:
Sample Address: SPRAYER 1500 HARD RD
Sample ID:

Private
County: FRANKLIN
Chlorinated:
Repeat No:
C12 Total:
C12 Free:
C12 Combined:

Test Requested	Lab	Method	Analyst	Date
Test Result	Number	Number	Number	Analyzed
LEAD	64748	3113B	4792	07/26/16
<5.0 ug/l				

Public Drinking Water Analysis Results, as Required by OEPA,
are Reported Following Final QA/QC